



50 NORTH PLAN

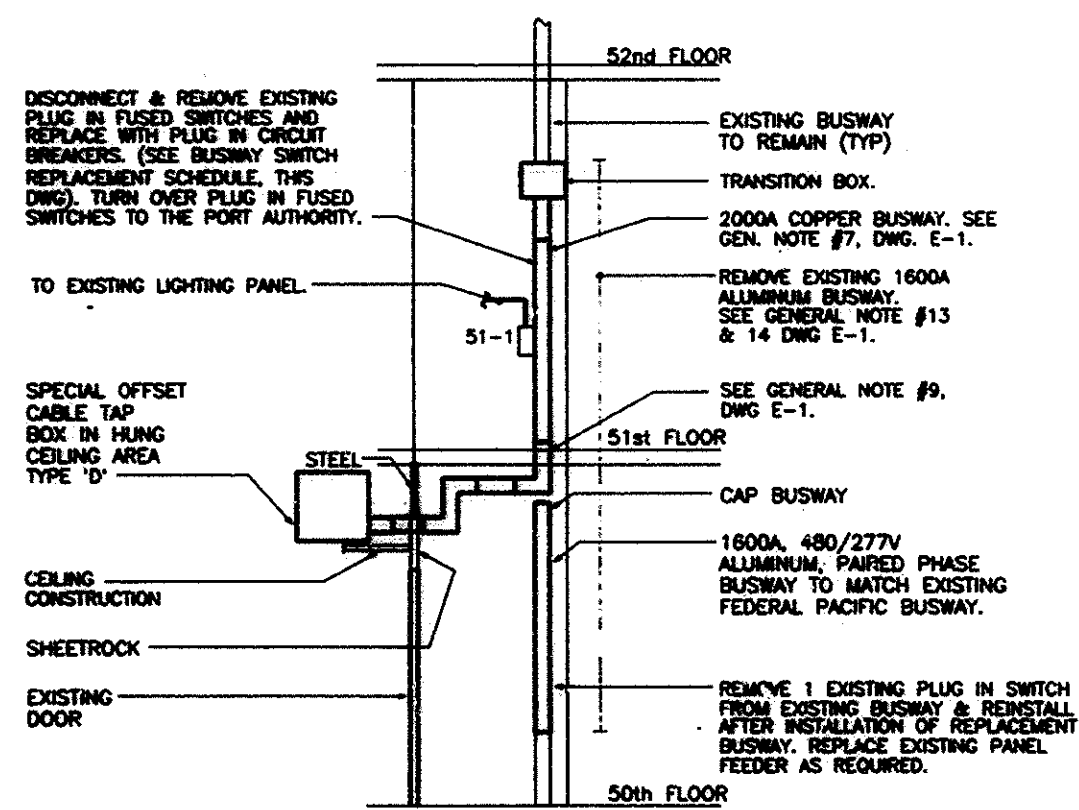

50th FLOOR SECTION A-A  
& PART RISER

NOTES:  
1. SEE DRAWING E-1 FOR GENERAL NOTES AND BUSWAY SCHEDULE.

BUSWAY SWITCH REPLACEMENT SCHEDULE						
#	EXIST. SW. SIZE	EXIST. FUSE RATING	NEW BREAKER RATING	NEW FEEDER	NEW COT	REMARKS
51-1	200A	125A	225AF/125AT	4#1 CU	1 1/2"	

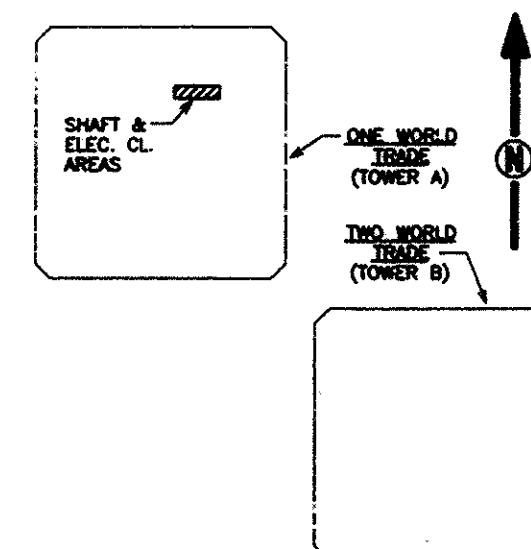

WORK AREA KEY PLAN

Sheet 22 of 41

**EDWARDS AND ZUCK, P.C.**  
CONSULTING ENGINEERS  
330 West 42nd Street, New York, NY 10036  
212-725-3400  
© 1992 Edwards and Zuck, P.C.

*James A. Zuck*  
Engineering Program Manager

**EDWARDS AND ZUCK, P.C.**  
CONSULTING ENGINEERS  
330 West 42nd Street, New York, NY 10036  
212-725-3400  
© 1992 Edwards and Zuck, P.C.



10/15/91 Drawings of Record  
No. Date Revision Approved

Engineering Department  
Design Division

The World Trade Center  
Electrical/HVAC  
Upgrade Program

LOW VOLTAGE DISTRIBUTION  
**ONE WTC ELECTRICAL**  
**80TH FLOOR**  
NORTH SIDE  
ELECTRIC CLOSET PART PLAN

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

CJ/CAD NW/CADD FJL  
Designed by Drawn by Checked by

Date 10/4/93 Scale 1/4" = 1'-0"

Contract Number Drawing Number

**WTC-804.041 E-5**

FILE NAME: E-5